

LIMITS OF APPLICABILITY

- USE OF THIS DOCUMENT SHALL NOT PERMIT THE APPLICANT
 TO MODIFY ANY PORTION(S) OF THIS PLAN OR THESE DETAILS

BUILDING DIVISION

STANDARD BLOCK WALL PLAN

NO RETAINING IS PERMITTED EXCEPT AS NOTED IN DETAILS BELOW (6" MAXIMUM OFFSET)



SCOPE:


- 1) STANDARD PLAN IS A GUIDELINE AND APPLIES TO NORMAL CONDITION. A PROFESSIONAL ENGINEER SHALL BE CONSULTED WHERE UNUSUAL CONDITIONS EXIST.
- 2) WALL SHALL NOT BE USED TO RETAIN EARTH. (6" MAX OFFSET)
- 3) THIS STANDARD PLAN SHALL NOT BE USED ON SITES WHERE LANDSLIDES ARE IDENTIFIED BY GIS MAPPING.
- 4) THIS STANDARD PLAN SHALL NOT BE USED ON SITES LOCATED IN A SPECIAL FLOOD HAZARD AREA VE ZONE.

APPLICABLE STANDARDS:

2025 CALIFORNIA RESIDENTIAL CODE (CRC), 2025 CALIFORNIA BUILDING CODE (CBC) ASCE 7-22; 2025 CALIFORNIA PLUMBING CODE (CPC), 2025 CALIFORNIA ELECTRICAL CODE (CEC); 2025 CALIFORNIA MECHANICAL CODE (CMC), 2025 CALIFORNIA ENERGY CODE (CEC); 2025 CALIFORNIA GREEN BUILDING STANDARDS CODE (CGBG); AND THE NEWPORT BEACH MUNICIPAL CODE (NBMIC)



GENERAL NOTES:

1. CONCRETE BLOCK (ASTM C-90) STRENGTH OF MASONRY TO COMPLY WITH 2025 CBC 2105 AND ACI 530-14. GRADE "N" CONFORMING TO ASTM C-90 NORMAL WEIGHT UNITS WITH MAXIMUM LINEAR SHRINKAGE OF 0.06%, $f_m = 2,000$ PSI MIN. CBC 2105.2
2. CONCRETE CONCRETE MIX SHALL BE TYPE V 4,500 PSI. CONCRETE JUSTIFIED BY TESTING TO BE IN NON-CORROSIVE ENVIRONMENT AND NOT IN (NON-SALT WATER, MARINE, OR IN CONTACT WITH SULFATES/SOILS) MAY BE TYPE II 2,500 PSI STRENGTH. CRC R404.1
3. GROUT GROUT SHALL HAVE A COMPRESSIVE STRENGTH OF 2,000 PSI AT 28 DAYS.
4. MORTAR (ASTM C-270) MORTAR SHALL BE OF TYPE "S" HAVING MIN. STRENGTH OF 2,000 PSI.
5. STEEL REINFORCING BARS (ASTM 615) REINFORCING BARS SHALL BE MIN GRADE 40, $F_y = 40$ KSI FOR #4 AND SMALLER AND GRADE 60, $F_y = 60$ KSI FOR #5 AND LARGER AS PER ASTM B16.1 BILLET STEEL. CRC R402.3
6. EXPANSION JOINTS EXPANSION JOINTS SPACING SHALL NOT EXCEED 30 FT LENGTH.
7. CLEAN OUTS PROVIDE CLEAN OUTS FOR ALL LIFTS GREATER THAN 4 FT.
8. BLOCK PATTERN BLOCKS SHALL BE INSTALLED IN RUNNING BOND SUCH THAT THE HEAD JOINTS IN SUCCESSIVE COURSES ARE HORIZONTALLY OFFSET AT LEAST 1/4 UNIT LENGTHS.
9. FOOTINGS BOTTOM OF FOOTING SHALL BE LEVEL. STEPPED FOOTING SHALL HAVE THE HORIZONTAL OVERLAP EQUAL TWICE THE VERTICAL STEP. USE MIN. OF (2) #4 BARS (2 BARS) TOP AND BOTTOM AT STEP. THERE SHALL BE MIN. 3 INCH COVER FOR ALL REINFORCING BARS IN CONCRETE FOOTING CAST AGAINST EARTH. CRC R608.5.4.1
10. FINISHED GRADE SOIL SHALL BE OF EQUAL ELEVATION ON EACH SIDE OF THE FENCE WALL. MAXIMUM OF 6 INCHES OFFSET IS PERMITTED IN THE GRADE LEVEL PROVIDED IT DOES NOT SUPPORT OTHER SURCHARGE LOADS. CRC R404.1.6
11. SOILS FOOTING DEPTH SHALL BE MIN 12 INCHES INTO UNDISTURBED NATURAL SOILS. FOOTINGS SHALL BE MIN OF 24 INCHES DEEP IN MAPPED LIQUEFACTION ZONE AND SHALL HAVE MIN (2) #5 TOP AND BOTTOM (SEE BUILDING DEPARTMENT 'G.I.S.' MAPPING FOR AREAS PRONE TO LIQUEFACTION). CRC R403.1.4
12. GROUTING ALL CELLS SHALL BE SOLID GROUTED IN WALLS.
13. STEEL BARS LOCATION STEEL REINFORCING BARS SHALL BE PLACED IN THE CENTER, ALL BAR LAPS SHALL BE 48 BAR DIAMETERS. IN NO CASE SHALL THE CONCRETE COVER AROUND BARS BE LESS THAN 1 1/2 INCHES (37 MM) (ADJACENT TO SOILS) REINFORCING BARS SHALL BE CLEAN OF ALL RUST.
14. PROPERTY CORNERS PROPERTY CORNERS SHALL BE MONUMENTED (LOCATED) BY A LICENSED SURVEYOR PRIOR TO STARTING THE CONSTRUCTION.
15. SHARED COMMON WALLS COMMON WALLS SHALL BE DOCUMENTED BY JOINT AGREEMENT TO 80' LOTS IN WRITING. EVIDENCE OF SIGNED JOINT AGREEMENT SHALL BE FILED WITH THE CITY AT TIME OF PERMIT ISSUANCE.
16. PROJECTIONS NO PROJECTIONS ALLOWED IN THE PUBLIC RIGHT OF WAY INCLUDING STONE CAP OR TRIM.
17. SITE WALLS SITE WALL IS STANDING ALONE. NON RETAINING MAY NOT FORM PART OF BUILDING OR OTHER STRUCTURE.
18. RAILING/GUARD NO RAILING, GUARD, OR SCREEN ATTACHMENTS ARE PERMITTED WHERE THE WALL HEIGHT PLUS THE RAIL, GUARD, OR SCREEN HEIGHT EXCEEDS 6'0" ABOVE LOWEST ADJACENT GRADE.
19. PERMIT REQUIREMENT NO BUILDING PERMIT IS REQUIRED WHEN WALL HEIGHT "H" IS LESS THAN 3'-6" AND WALL IS NOT WITHIN 3'-0" OF PROPERTY LINE. NBMIC 15.02.080.

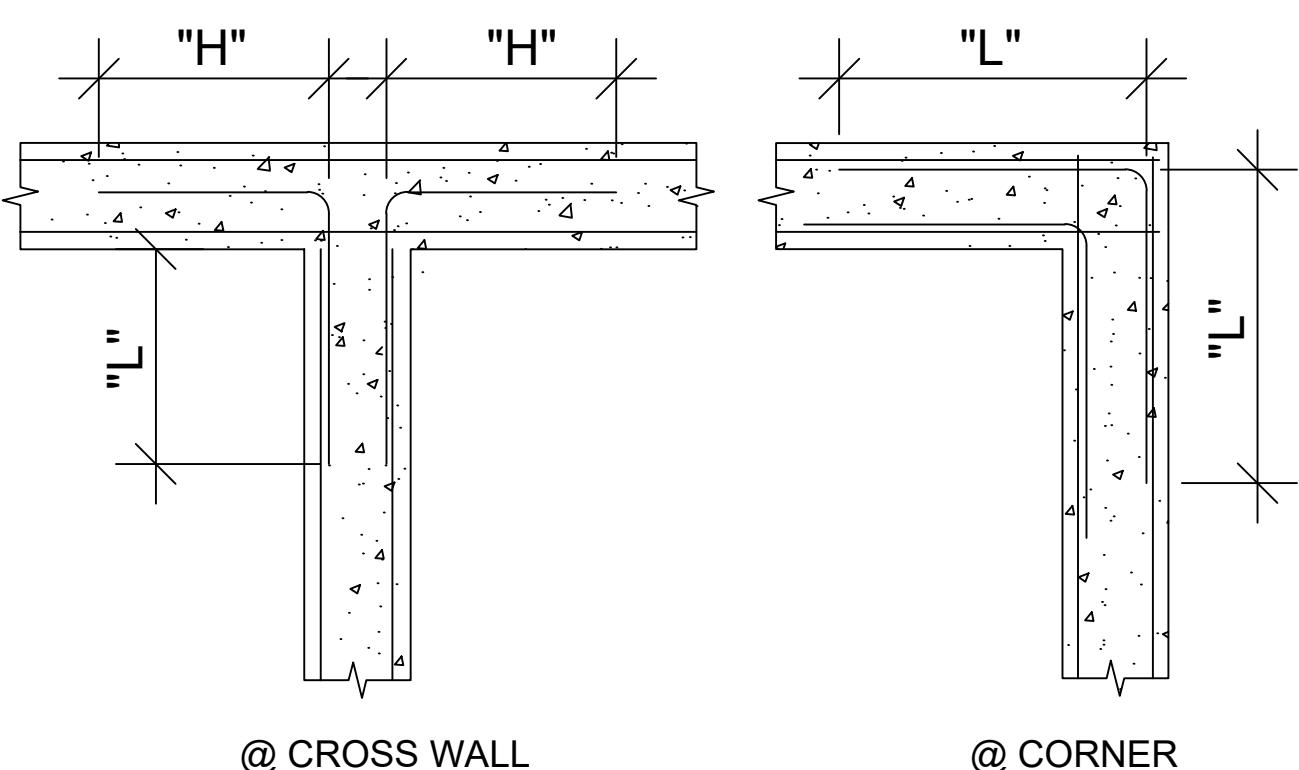


| BAR | STRAIGHT LAP (L) | HOOK LAP (H) |
|-----|------------------|--------------|
| #4 | 20" | 10" |
| #5 | 24" | 12" |

NOTE: ALL HOOKS TO CONFIRM TO ACI 318

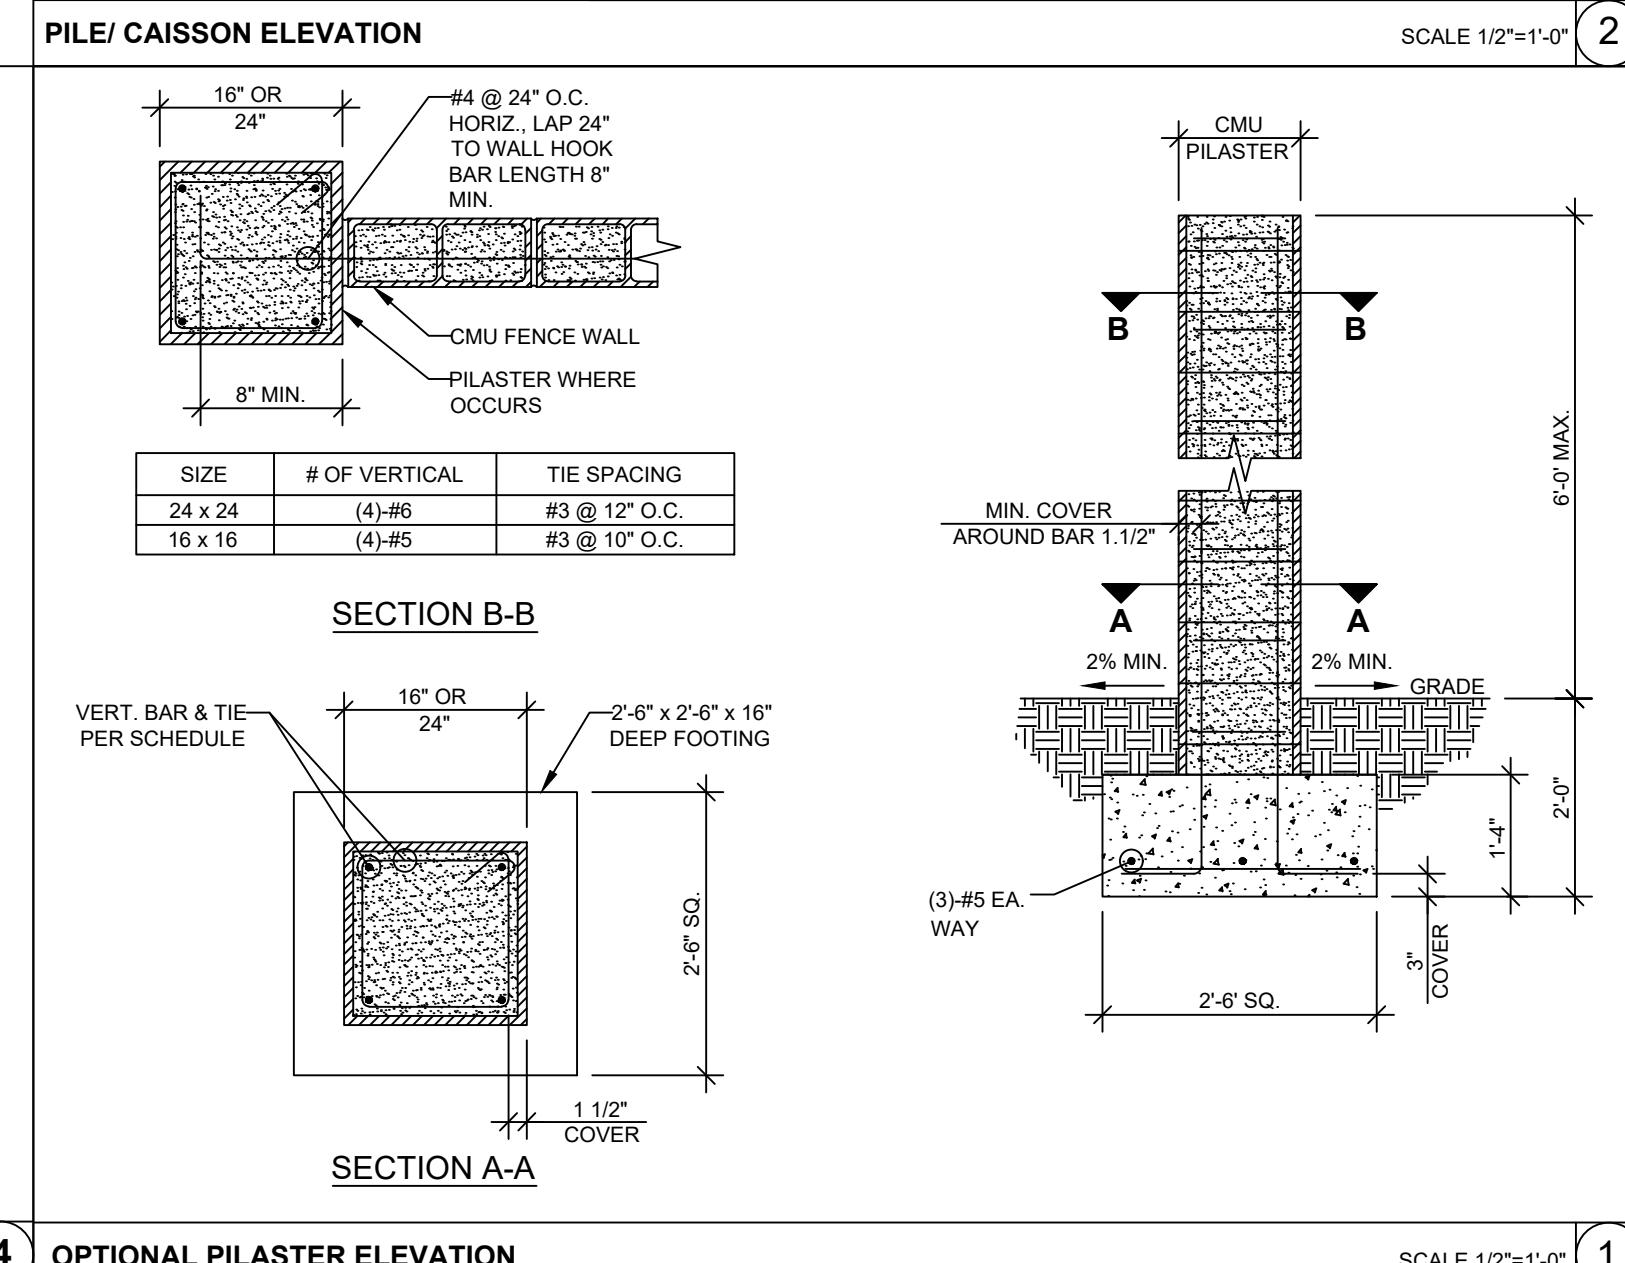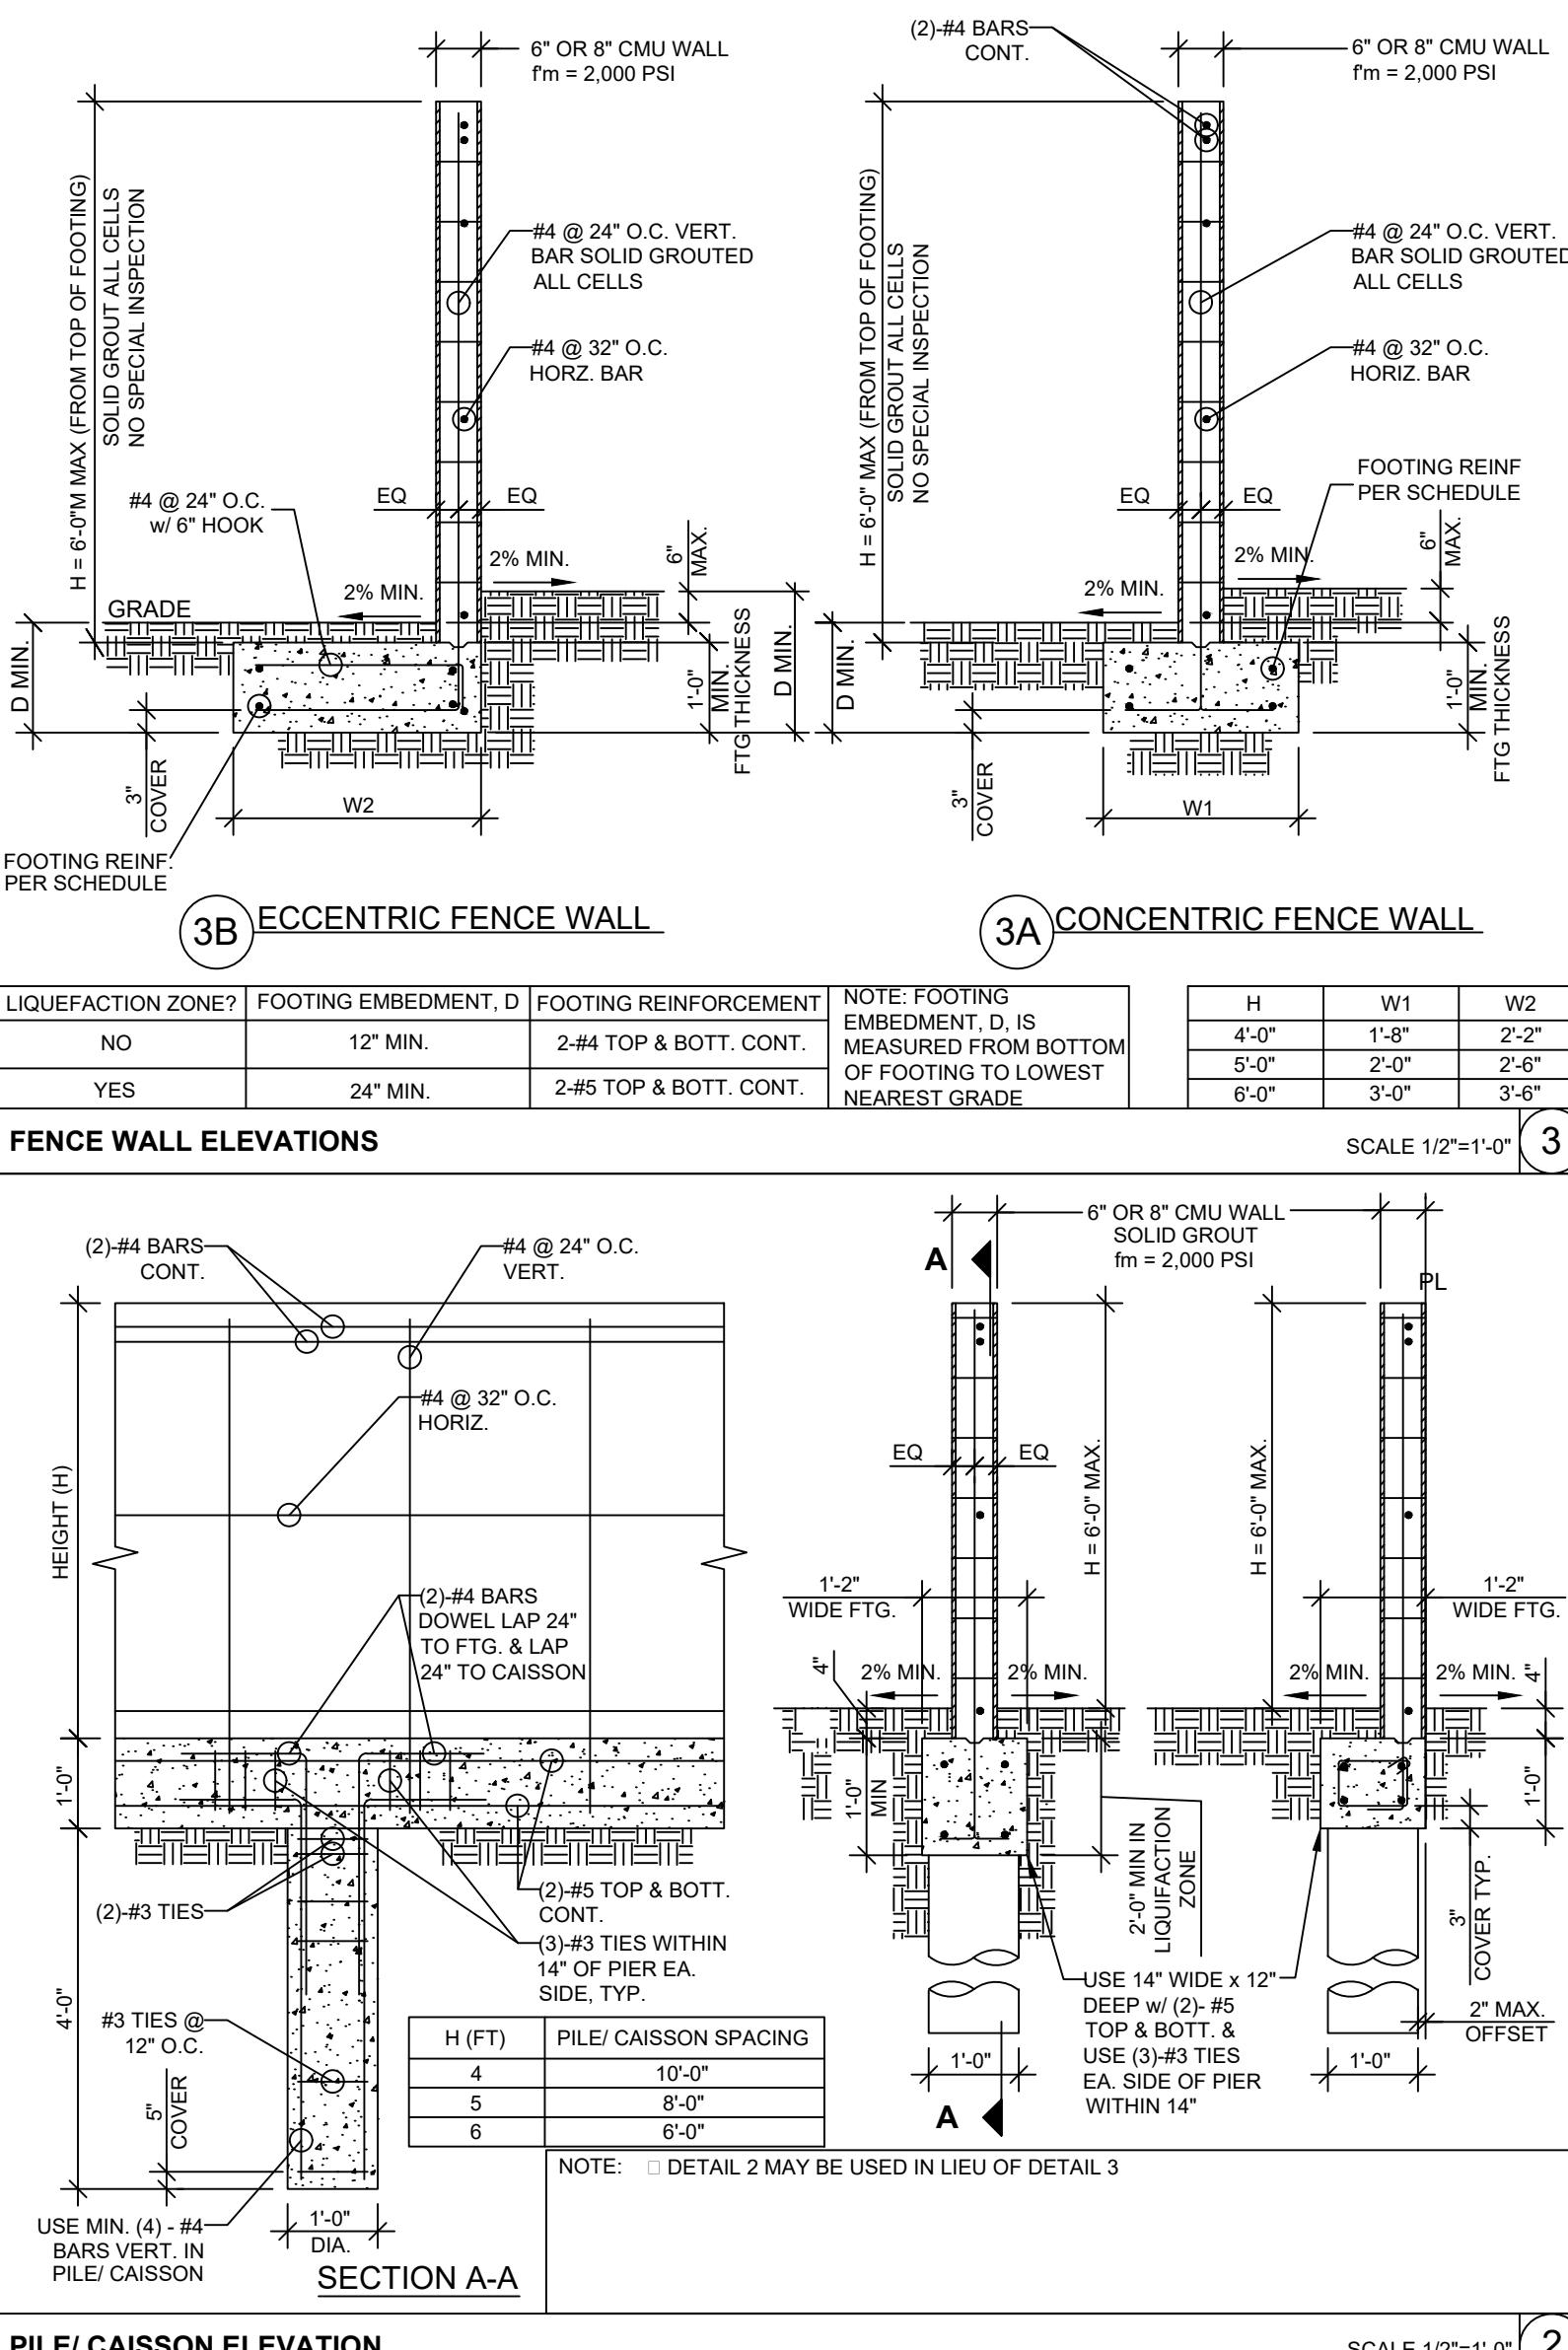


INSTRUCTIONS:
 SKETCH YOUR PROPERTY IN THE SPACE PROVIDED ON YOUR RIGHT, SHOWING THE FOLLOWING:
 A. LABEL PROPERTY LINES.
 B. SHOW LOCATION OF WALLS AND PILASTER RELATIVE TO PROPERTY LINES.
 C. DIMENSION THE LENGTH OF EACH WALL.
 D. SPECIFY THE HEIGHT OF EACH WALL.
 E. SPECIFY THE RELATIVE ELEVATION OF ADJOINING PROPERTY (HIGHER, LOWER).
 F. IF THE WALL IS IN A LIQUEFACTION ZONE, INDICATE WITHIN FIVE FEET OF FENCE LOCATION.
 G. SPECIFY THE CITY SECTION DETAIL NUMBER TO BE USED.
 H. SHOW PUBLIC EASEMENT (IF ANY).
 J. I. THE MAIN ENTRY ON THE SIDE YARD. YES NO (PLANNING APPROVAL IS REQUIRED)
 K. SHOW ANY PROJECTION OF WALLS, PILASTERS, AND FOUNDATION BEYOND THE PROPERTY LINE. ALSO, PROVIDE A SIGNED LETTER OF AUTHORIZATION FOR SUCH PROJECTION FROM AFFECTED NEIGHBORS.
 L. IF THE CONSTRUCTION OF THE WALL IS ADJACENT TO THE SLOPE, THEN THE MAXIMUM FOOTING EMBEDMENT SHALL BE H-3 OR 7'-0" TO THE FACE OF THE SLOPE.

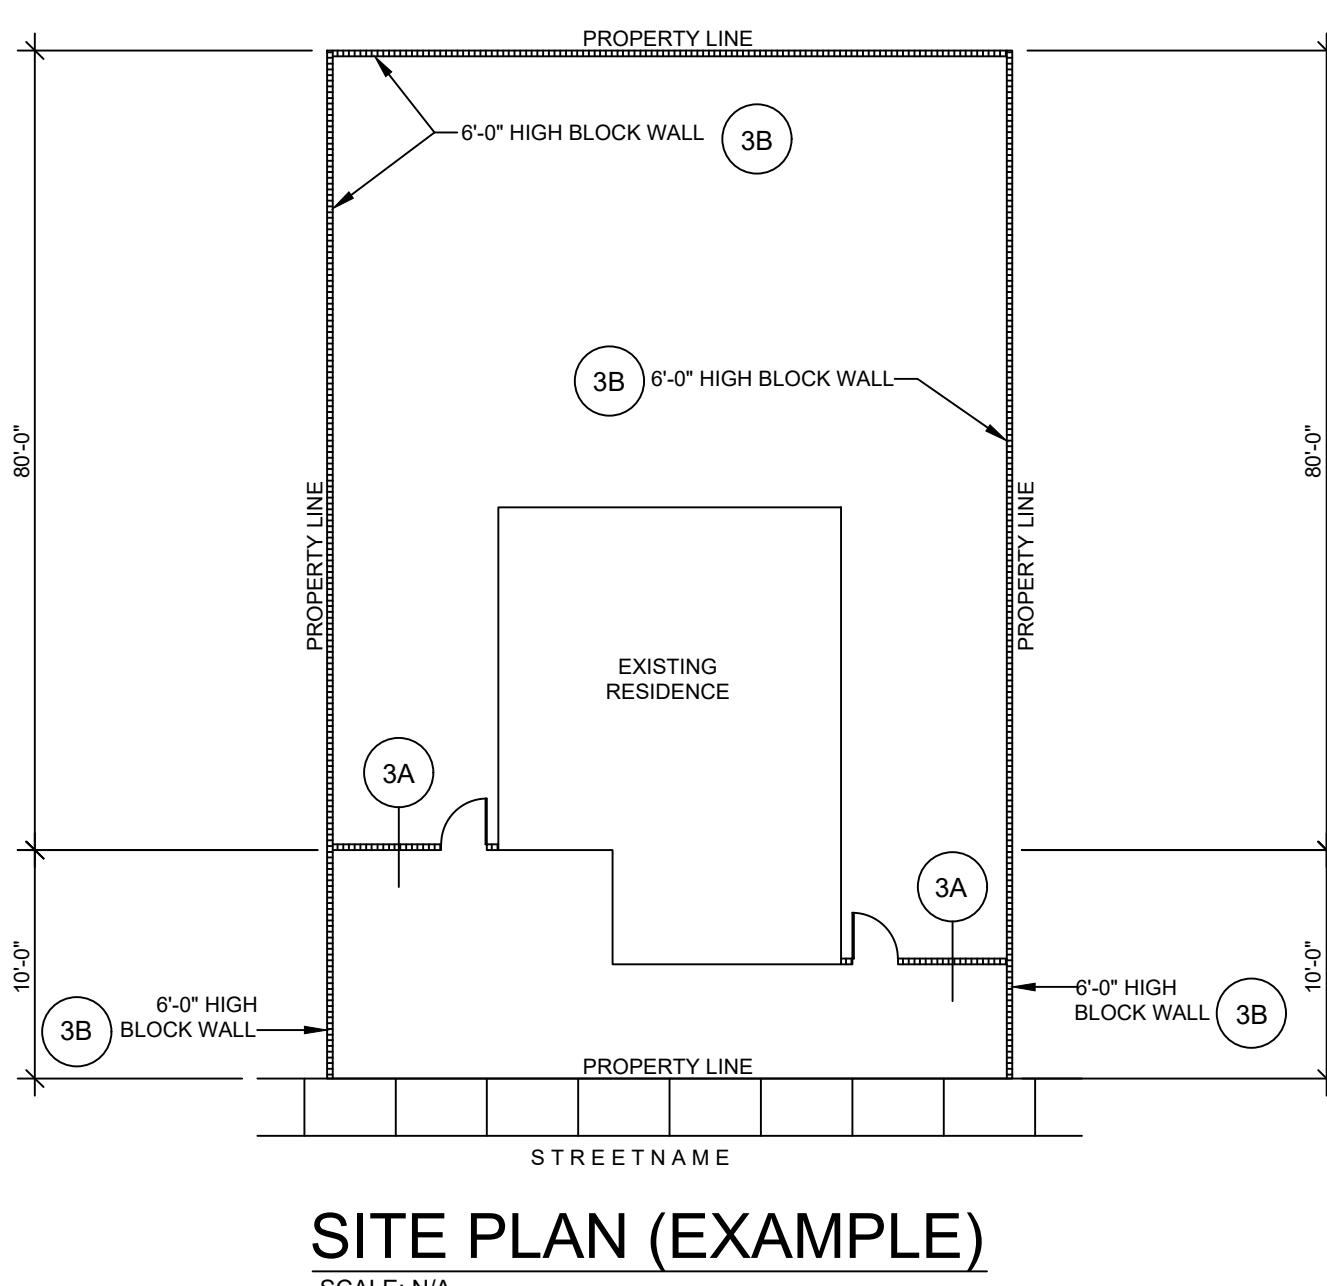

SITE PLAN (EXAMPLE)

SCALE: N/A

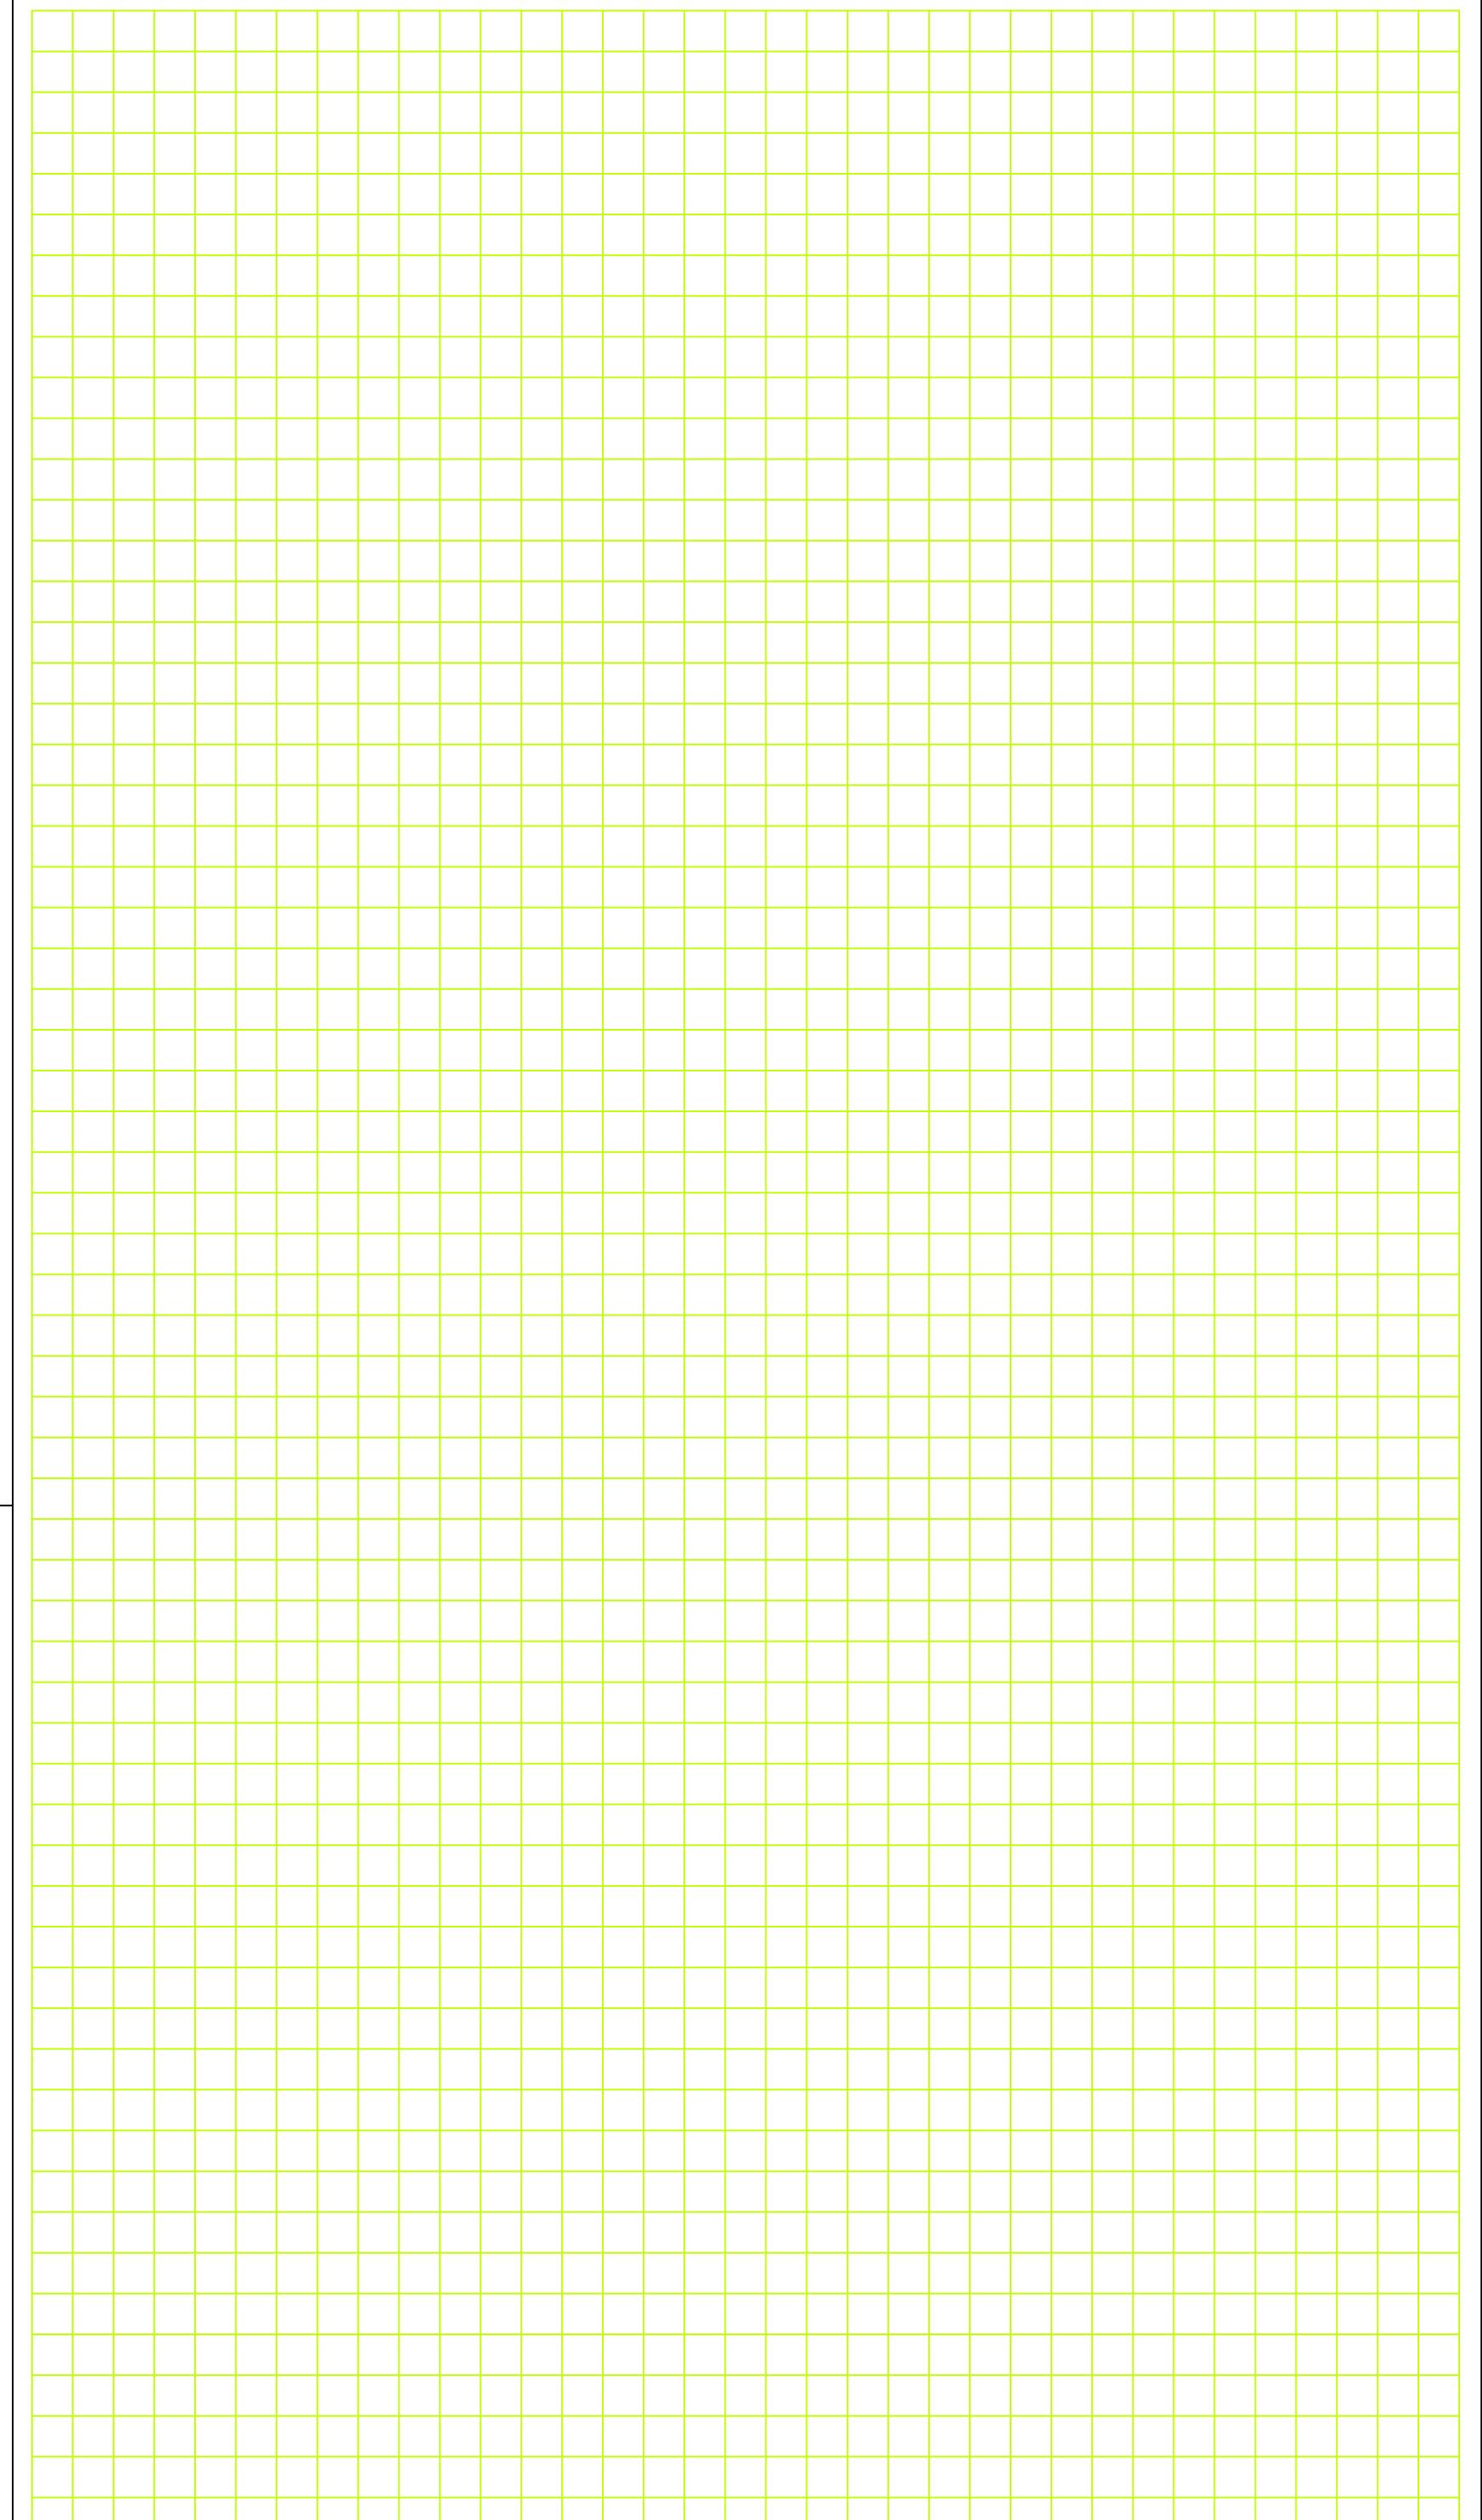

SITE PLAN

SCALE 1/8"=1'-0"

SIDE YARD SETBACK BY PLANNER:

SCOPE OF WORK:

LIQUEFACTION ZONE: YES NO

PROJECT ADDRESS:

OWNER'S NAME: PLAN PREPARER:

TEL. NO.: CONTACT INFO:

SIGNATURE: LICENSE NO.: